

NOTES:

- (1) EVERY PART OF THE PLUMBING SYSTEM SHALL BE PROTECTED FROM FREEZING THROUGH THE USE OF AN APPROVED METHOD.
- (2) WEeping TILES SHALL NOT TO BE CONNECTED TO THE SANITARY SYSTEM.
- (3) BACKFLOW PREVENTORS SHALL BE INSTALLED BY LOT OWNERS ON ALL SANITARY SERVICES.
- (4) ROOF LEADERS SHALL DISCHARGE TO THE SURFACE.
- (5) SUMP PUMP TO DISCHARGE INTO THIRD PIPE AT FRONT OF HOUSE. SIDE YARD LOCATION IS NOT PERMITTED.


Scale:	N.T.S.
Drawn By:	Tim Schaap
Checked By:	
Approved:	
Date:	DEC. 2001



REGIONAL MUNICIPALITY OF WOOD BUFFALO

WEeping TILE DISCHARGE

Figure 804-1
Clearance Required from the Service Regulator Relief Vent

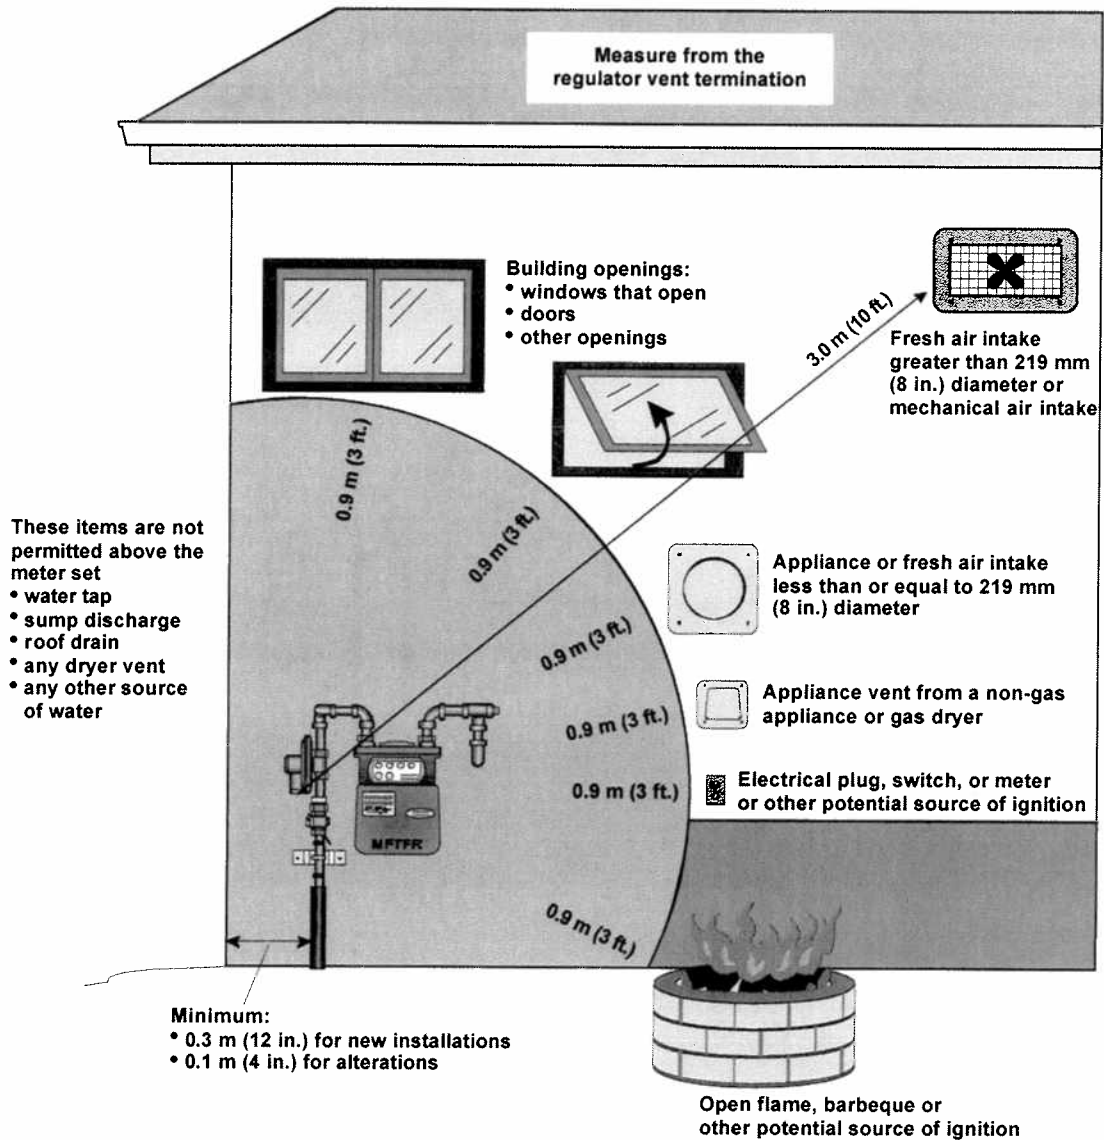


Notes:

Increase the distance for building openings and appliance or fresh air intakes to 3.0m (10 ft.) when the relief capacity of the regulator exceeds 55 m³/hr (1900 scfh).

Check overhead for hazards such as falling snow or ice from quonset buildings or metal roofs.

Figure 804-2
Clearance Required between the Service Regulator Relief Vent
and Any Gas Appliance Vent

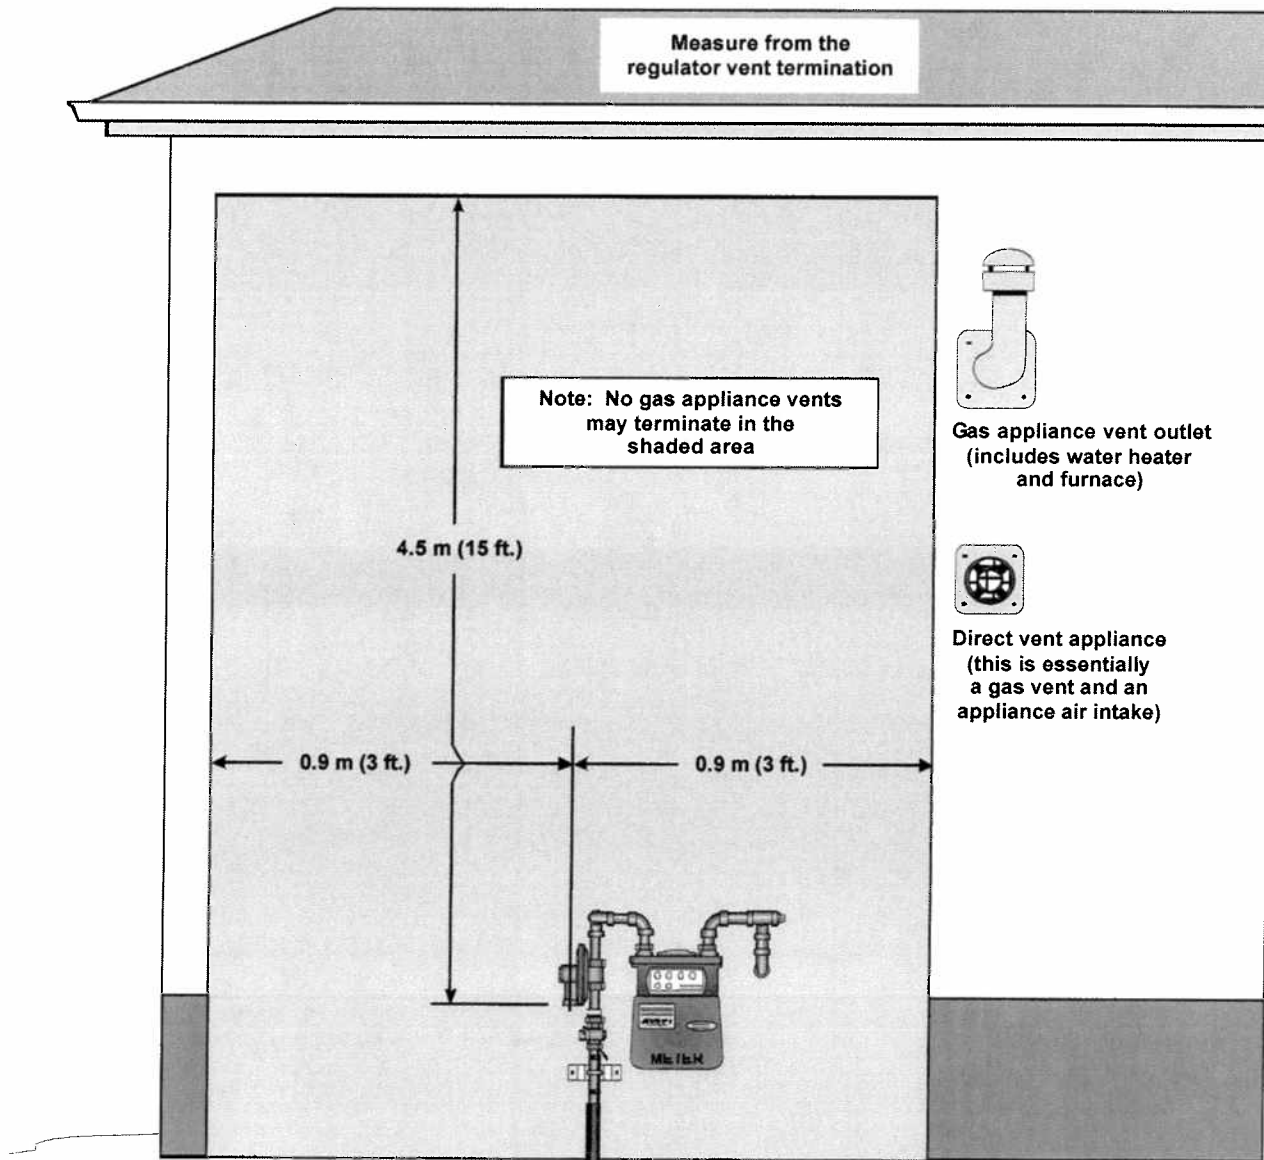

Note:
Increase the distance for direct vent appliances to 3.0m (10 ft.) when the relief capacity of the regulator exceeds 55 m³/hr (1900 scfh).